




- NOTES:
1. DRIP SHIELD IS OPTIONAL
  2. THE INSTALLATION OF THIS EQUIPMENT SHALL COMPLY WITH ALL LOCAL AUTHORITY AND APPLICABLE BUILDING CODES
  3. PROVIDE A MINIMUM CLEARANCE (FROM CHARGER CHASSIS) OF 6.0IN ON TOP, 4.0IN ON BOTTOM, AND 0.5IN ON SIDES OF UNIT FOR VENTILATION


| DCN    | REV. | DESCRIPTION     | DATE       | AUTHOR |
|--------|------|-----------------|------------|--------|
| 107342 | A    | INITIAL RELEASE | 9/8/2017   | ERS    |
| 108575 | B    | ADDED BREAKERS  | 12/12/2024 | AM     |

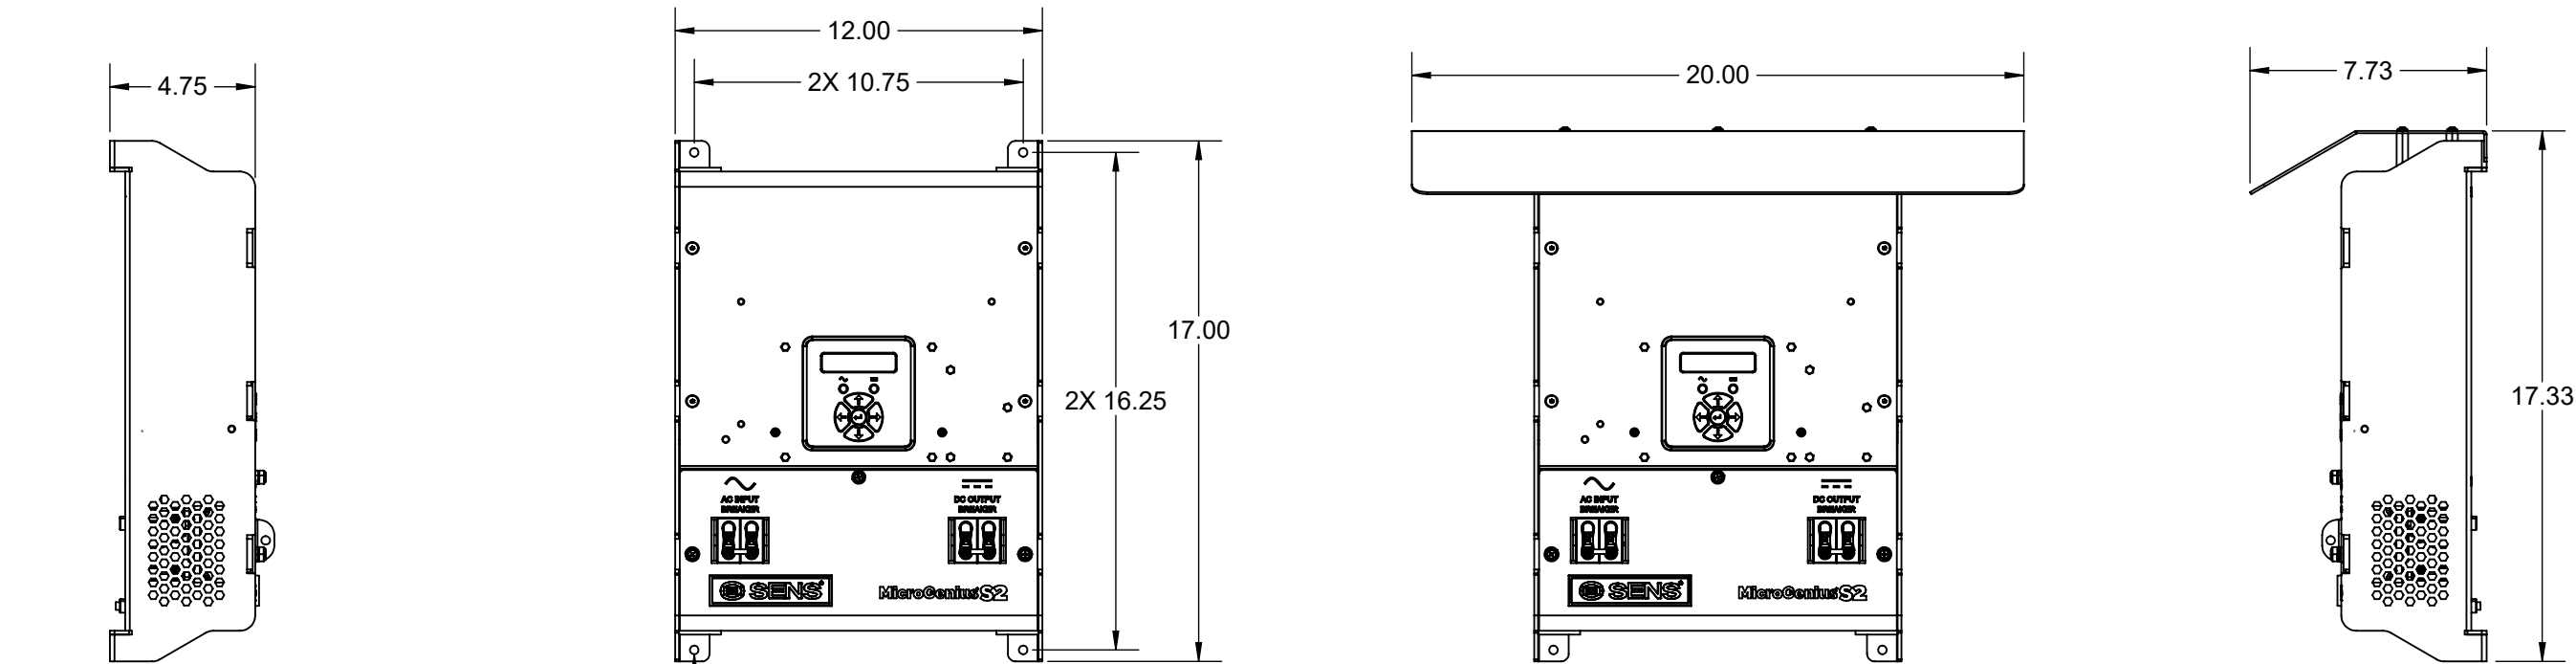

4X MOUNTING LOCATIONS  
FOR 1/4IN HARDWARE

THESE VIEWS SHOWN WITH OPTIONAL DRIP SHIELD

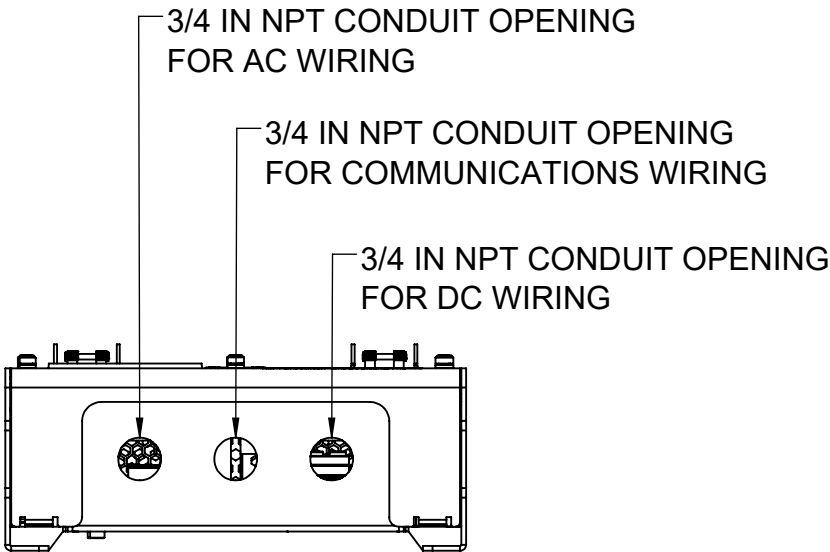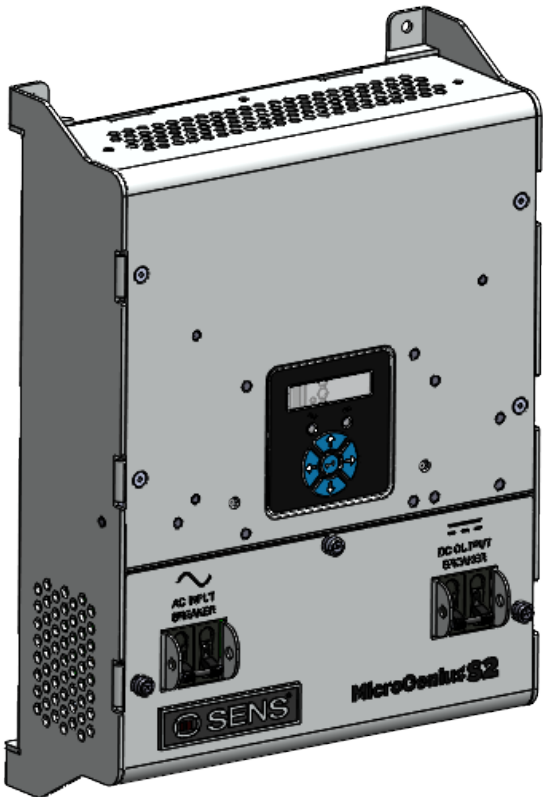

|  |   |  |   |                           |               |
|--|---|--|---|---------------------------|---------------|
| <div><b>SENS</b><br/>STORED ENERGY SYSTEMS<br/>1840 INDUSTRIAL CIRCLE LONGMONT, CO 80501<br/>303-478-7500 WWW.SENS-USA.COM</div> <div>PROPRIETARY AND CONFIDENTIAL: THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF STORED ENERGY SYSTEMS, LLC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF STORED ENERGY SYSTEMS, LLC, IS PROHIBITED.</div> | UNLESS OTHERWISE SPECIFIED FOR ALL SHEETS: DIMENSIONS ARE IN INCHES.<br>INCHES DO NOT SCALE DRAWING.<br>DEFAULT TOLERANCES: |  | ORIGINAL AUTHOR: AMANZO                       | PART NUMBER: 2DCAD-S2-STD | REVISION: B   |
|  | X.XXX±0.010 X.XX±0.030<br>ANGLES±1.5° HOLES±.003  |  | RELEASE DATE: 12/26/2024                      | DESCRIPTION: 2DCAD-S2-STD | SHEET: 1 OF 1 |
|  |   |  | SHEET FORMAT SIZE: B                          |                           |               |
|  |   |  | THIRD ANGLE PROJECTION                        |                           |               |
|  |   |  | DIMENSIONS & TOLERANCES PER ASME Y14.5 - 2009 |                           |               |