

REVISIONS				
DCN	REV	DESCRIPTION	DATE	APPROVED
PLC-IQ	A	INITIAL RELEASE	29 JUL 2007	TCG
105623	B	ADD COMM CARD POWER CONNECTIONS	22 SEP 2008	TCG
106061	C	UPDATE FILTER CAPS, 6AWG ALLOWED FOR 35A	19 DEC 2011	TCG
106471	D	REDRAWN AND UPDATED	19 FEB 2014	TCG
108061	E	DIGITAL CONTROL BOARD, PROTOCOL BOARD	02 SEP 2020	TCG
108082	F	UPDATE J4 SIGNAL NAMES	07 JUL 2021	TCG

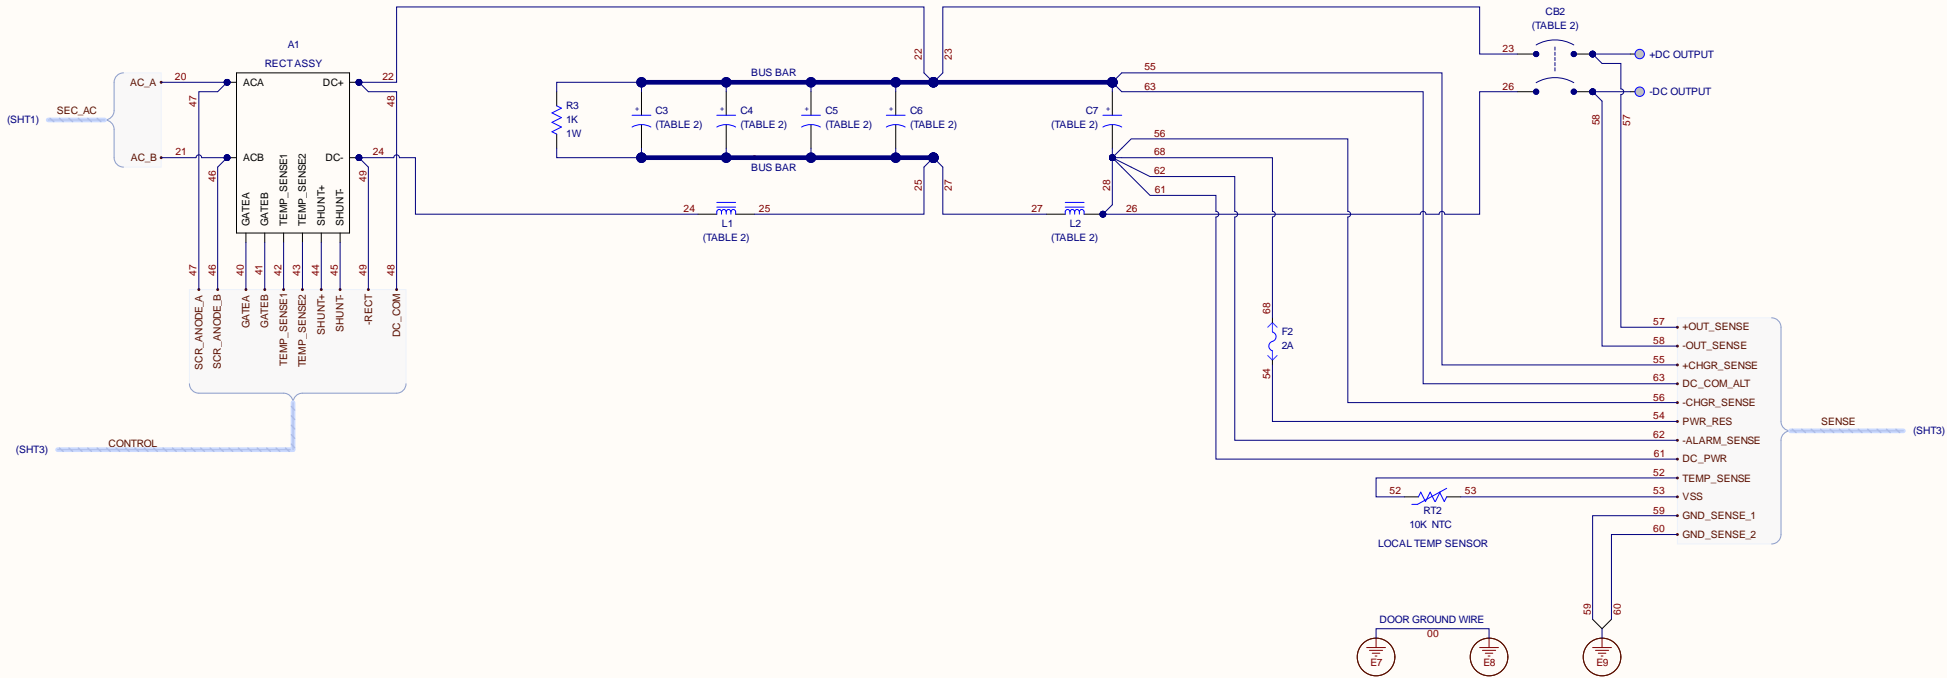


TABLE 2

OUTPUT	C3-C6	C7	L1	L2	CB2	PWR WIRES	GND WIRE
12V 35A	2X 68000uF 50V	68000uF 50V	602238	602281	45A 60VDC	8 OR 6 AWG	10 AWG
12V 50A	2X 68000uF 50V	68000uF 50V	602242	602284	70A 60VDC	6 AWG	6 AWG
12V 75A	2X 68000uF 50V	68000uF 50V	602246	602287	100A 60VDC	4 AWG	6 AWG
12V 100A	3X 68000uF 50V	68000uF 50V	602249	602289	125A 60VDC	2 AWG	6 AWG
12V 150A	4X 68000uF 50V	68000uF 50V	602252	602291	200A 125VDC	2X 4 AWG	6 AWG

NOTES

- OUTPUT CONFIGURATION FOR 12V MODELS WITH TWO STAGE OUTPUT FILTER, WITHOUT OUTPUT BLOCKING DIODES
- C3-C7, CB2, L1, AND L2 VARY WITH OUTPUT RATING. SEE TABLE 2.
- CONTROL AND SENSE HARNESSSES ARE 22 AWG MINIMUM. SEE TABLE 2 FOR DOOR GROUND AND OUTPUT POWER WIRES.
- TWO STAGE FILTERS ARE NOT USED FOR 12V 12A, 12V 16A, AND 12V 25A MODELS. THESE MODELS MEET LOW RIPPLE REQUIREMENTS USING A SINGLE STAGE FILTER.

PROPRIETARY INFORMATION		APPROVALS		STORED ENERGY SYSTEMS LONGMONT, CO	
THIS DRAWING AND DATA/EMBODY PROPRIETARY INFORMATION WHICH IS THE CONFIDENTIAL PROPERTY OF STORED ENERGY SYSTEMS LLC (SENS) AND WHICH SHALL NOT BE COPIED, REPRODUCED OR DISCLOSED TO OTHERS.		DESIGNER		WD, IQ, OUTPUT, 12V, 2 STG RECTIFIER, FILTER AND POWER OUTPUT	
		CHECKER		SIZE C	DWG NUMBER WD/00552
		ENGINEER		07 JUL 2021	REVISION F
		T. GROUT			SHEET 2 OF 3
© 2021 STORED ENERGY SYSTEMS, LLC		FILE: WD_00552_SCHDOC			